

**ADDENDUM NUMBER 3
NOVEMBER 28, 2018**

St. John the Baptist Parish Government
Drinking Water Revolving Loan Fund
Lions Water Treatment Plant Pump Station Intake Project
Project No. DWRLF – 1095003-01 Contract 2 Lions Intake

FROM:

BURK-KLEINPETER, INC.
ENGINEERS, ARCHITECTS, PLANNERS, ENVIRONMENTAL SCIENTISTS
4176 Canal Street, New Orleans, Louisiana 70119
TEL (504) 486-5901 FAX (504) 486-6228

TO: PROSPECTIVE BIDDERS

This addendum forms a part of the Contract Documents and modified Specification sections and Drawings as denoted below. Acknowledge receipt of this addendum in the space provided on the Bid Form. Failure to do so may subject the Bidder to disqualification. Bidder is responsible for disseminating this addendum to all subcontractors and material suppliers concerned.

Drawings


- D1. Sheet C2.0, remove this drawing and replace with the new Sheet C2.0 included with this Addendum No. 3.
- D2. Sheet M2.0, remove this drawing and replace with the new Sheet M2.0 included with this Addendum No. 3.




BKJ BURK-KLEINPETER, INC.
 ENGINEERS, ARCHITECTS, PLANNERS, ENVIRONMENTAL SCIENTISTS
 4176 CANAL STREET, NEW ORLEANS, LA 70119-5994
 PHONE (504)486-5901 • FAX (504)488-1714
 BKI JOB # NO.14.006

DESIGNED	T.M.	09/2018
CHECKED	R.B.	OF
DETAILED	T.L.	
CHECKED	A.M.	
DATE		
SHEET		

NO.	DATE	REVISION DESCRIPTION	BY
1	11-28-18	ADDENDUM NO. 3	
2	10-3-18	FOR BID	

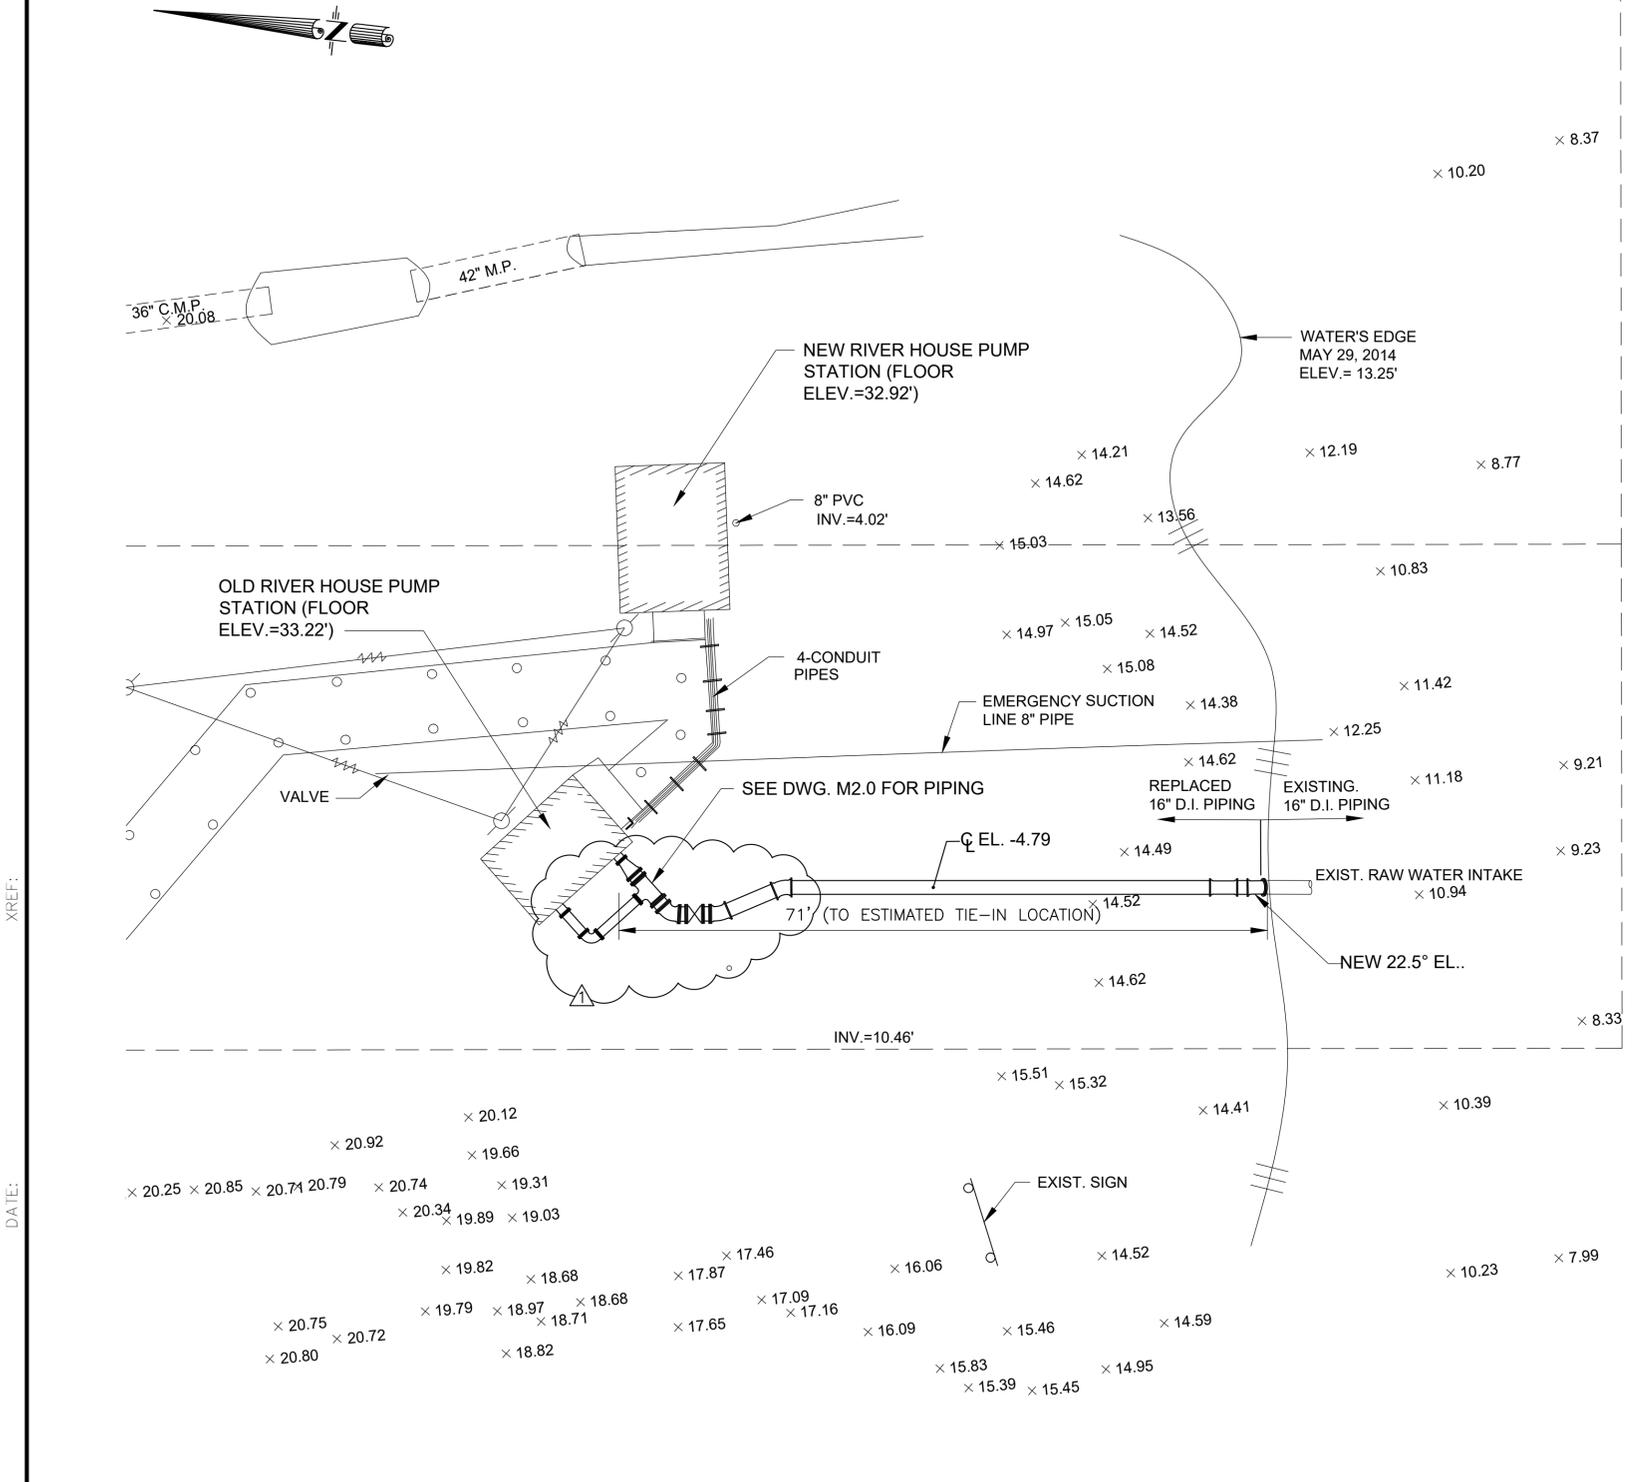

PLAN OF NEW RAW WATER INTAKE
 SCALE : 1"=10'-0"

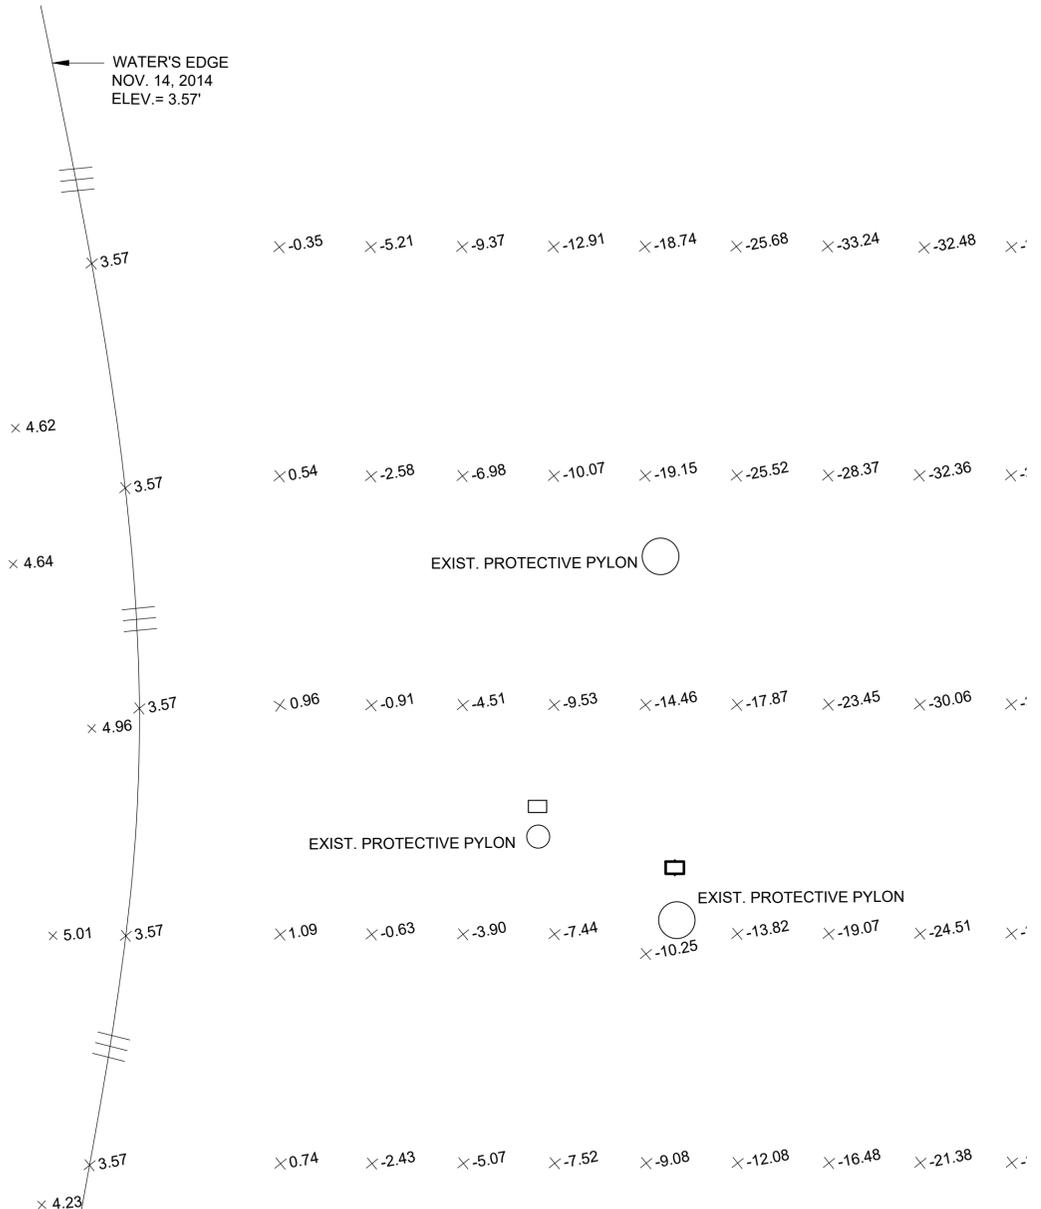

NOTES :

- CONTRACTOR SHALL LOCATE EXISTING INTAKE PIPE ALONG THE ENTIRE LENGTH OF THE REPLACEMENT LIMITS. INSERTION ELECTROMAGNET METHODS RECOMMENDED.
- CONTRACTOR SHALL VERIFY AND SUBMIT ELEVATIONS, IN PARTICULAR THE STATION BOTTOM FLOOR ELEVATION, PRIOR TO MOBILIZATION OR ORDERING OF MATERIALS.
- THE CONTRACTOR SHALL PERFORM THE REQUIRED EXCAVATION USING A PRE-MANUFACTURED TRENCH BOX OR SHALL SUPPLY ENGINEERING CALCULATIONS FOR THE REQUIRED SHEETING AND BRACING TO SHORE UP THE SIDE WALLS OF THE EXCAVATED TRENCH WITH A LA LICENSED PROFESSIONAL CIVIL ENGINEER'S STAMP ON THE CALCULATIONS.
- THE OPEN CUT EXCAVATION SHALL REMAIN OPEN ONLY AS LONG AS NECESSARY TO COMPLETE THE INSTALLATION OF THE NEW PIPE MATERIALS AND INSPECTION OF THE INSTALLATION AND TIE-INS. THEN THE OPEN TRENCH SHALL BE BACKFILLED AS SOON AS POSSIBLE ONCE THE INSTALLATION IS TESTED AND MEETS THE SPECIFICATIONS.
- CONTRACTOR IS PERMITTED TO INSTALL AN INSERTION TYPE VALVE OR STOPPLE IN THE INTAKE LINE (NOT SHOWN) TO ASSIST IN PIPING INSTALLATION.

XREF:



DATE:

FILE NAME:



DESIGNED	T.M.	08/2018
CHECKED	R.B.	
DETAILED	T.L.	
CHECKED	A.M.	

NO.	DATE	REVISION DESCRIPTION	BY
11-28-18		ADDENDUM NO. 3- RE-ISSUED	
10-3-18		FOR BID	

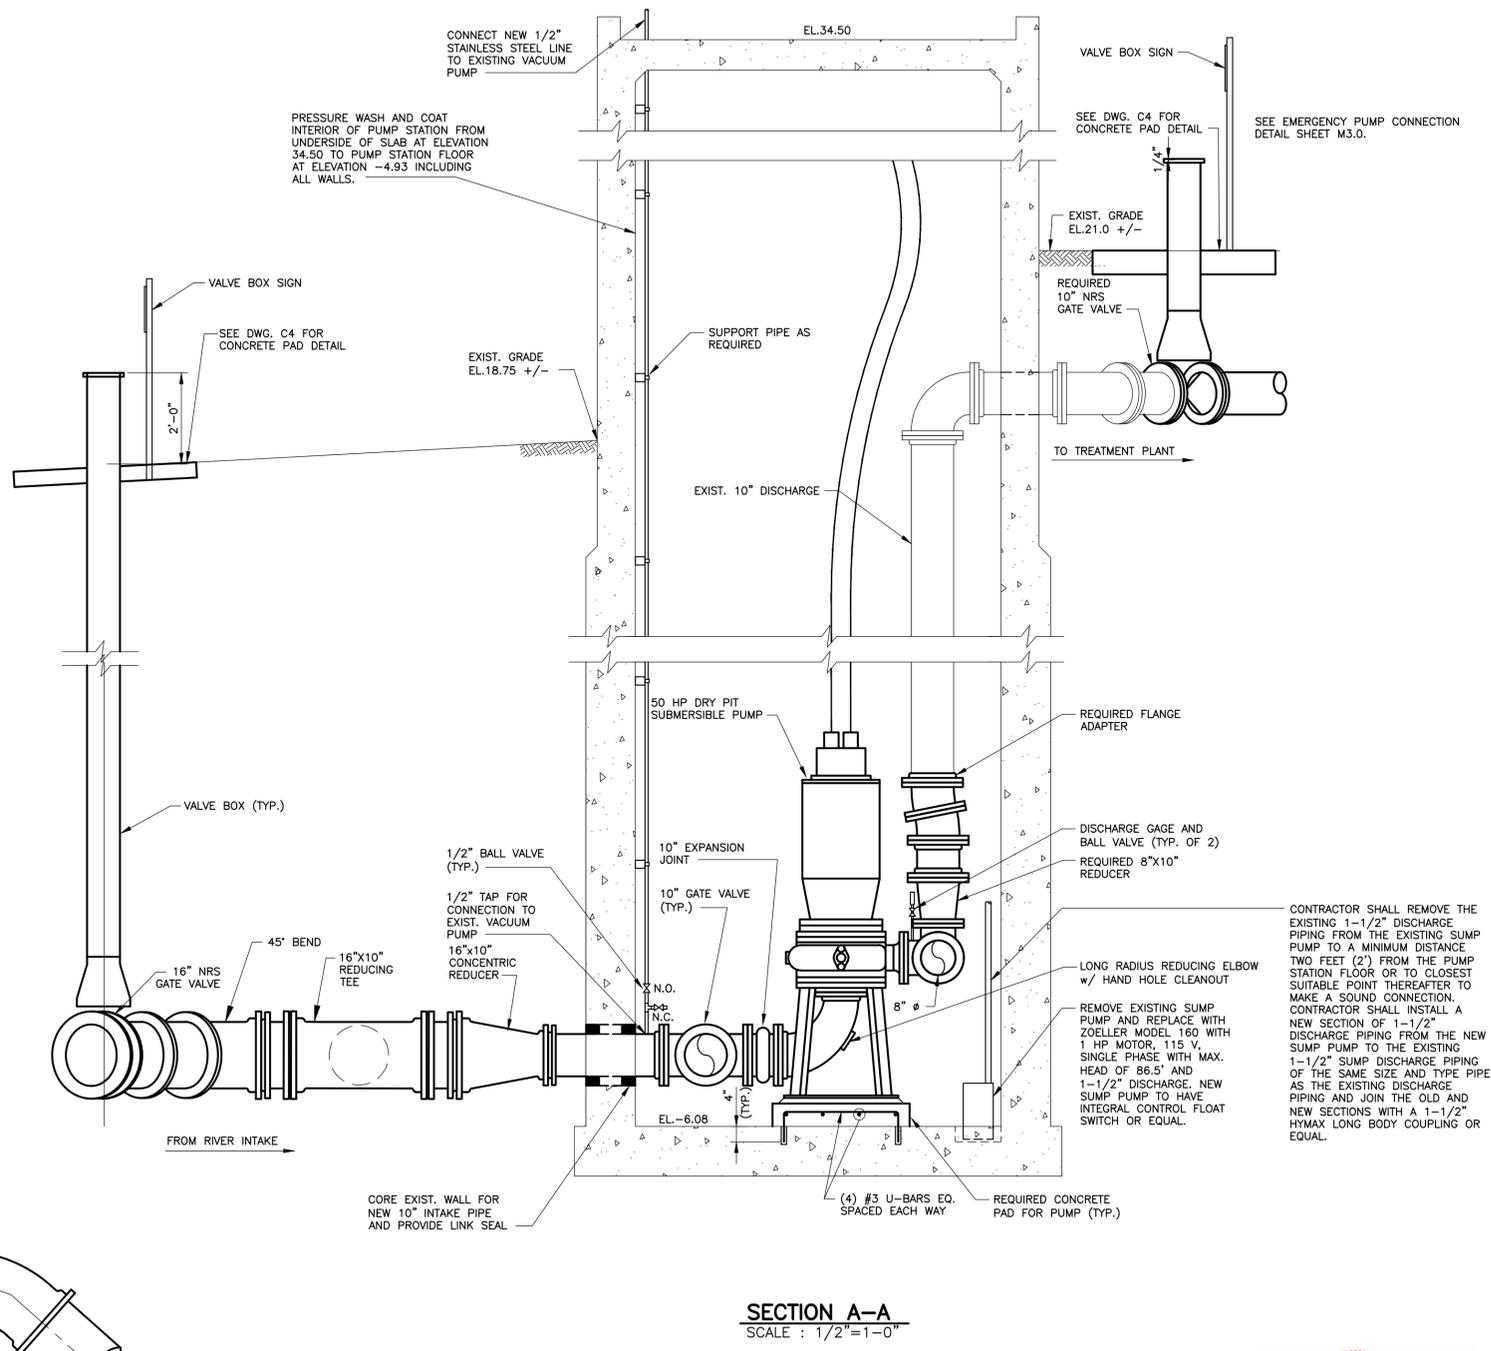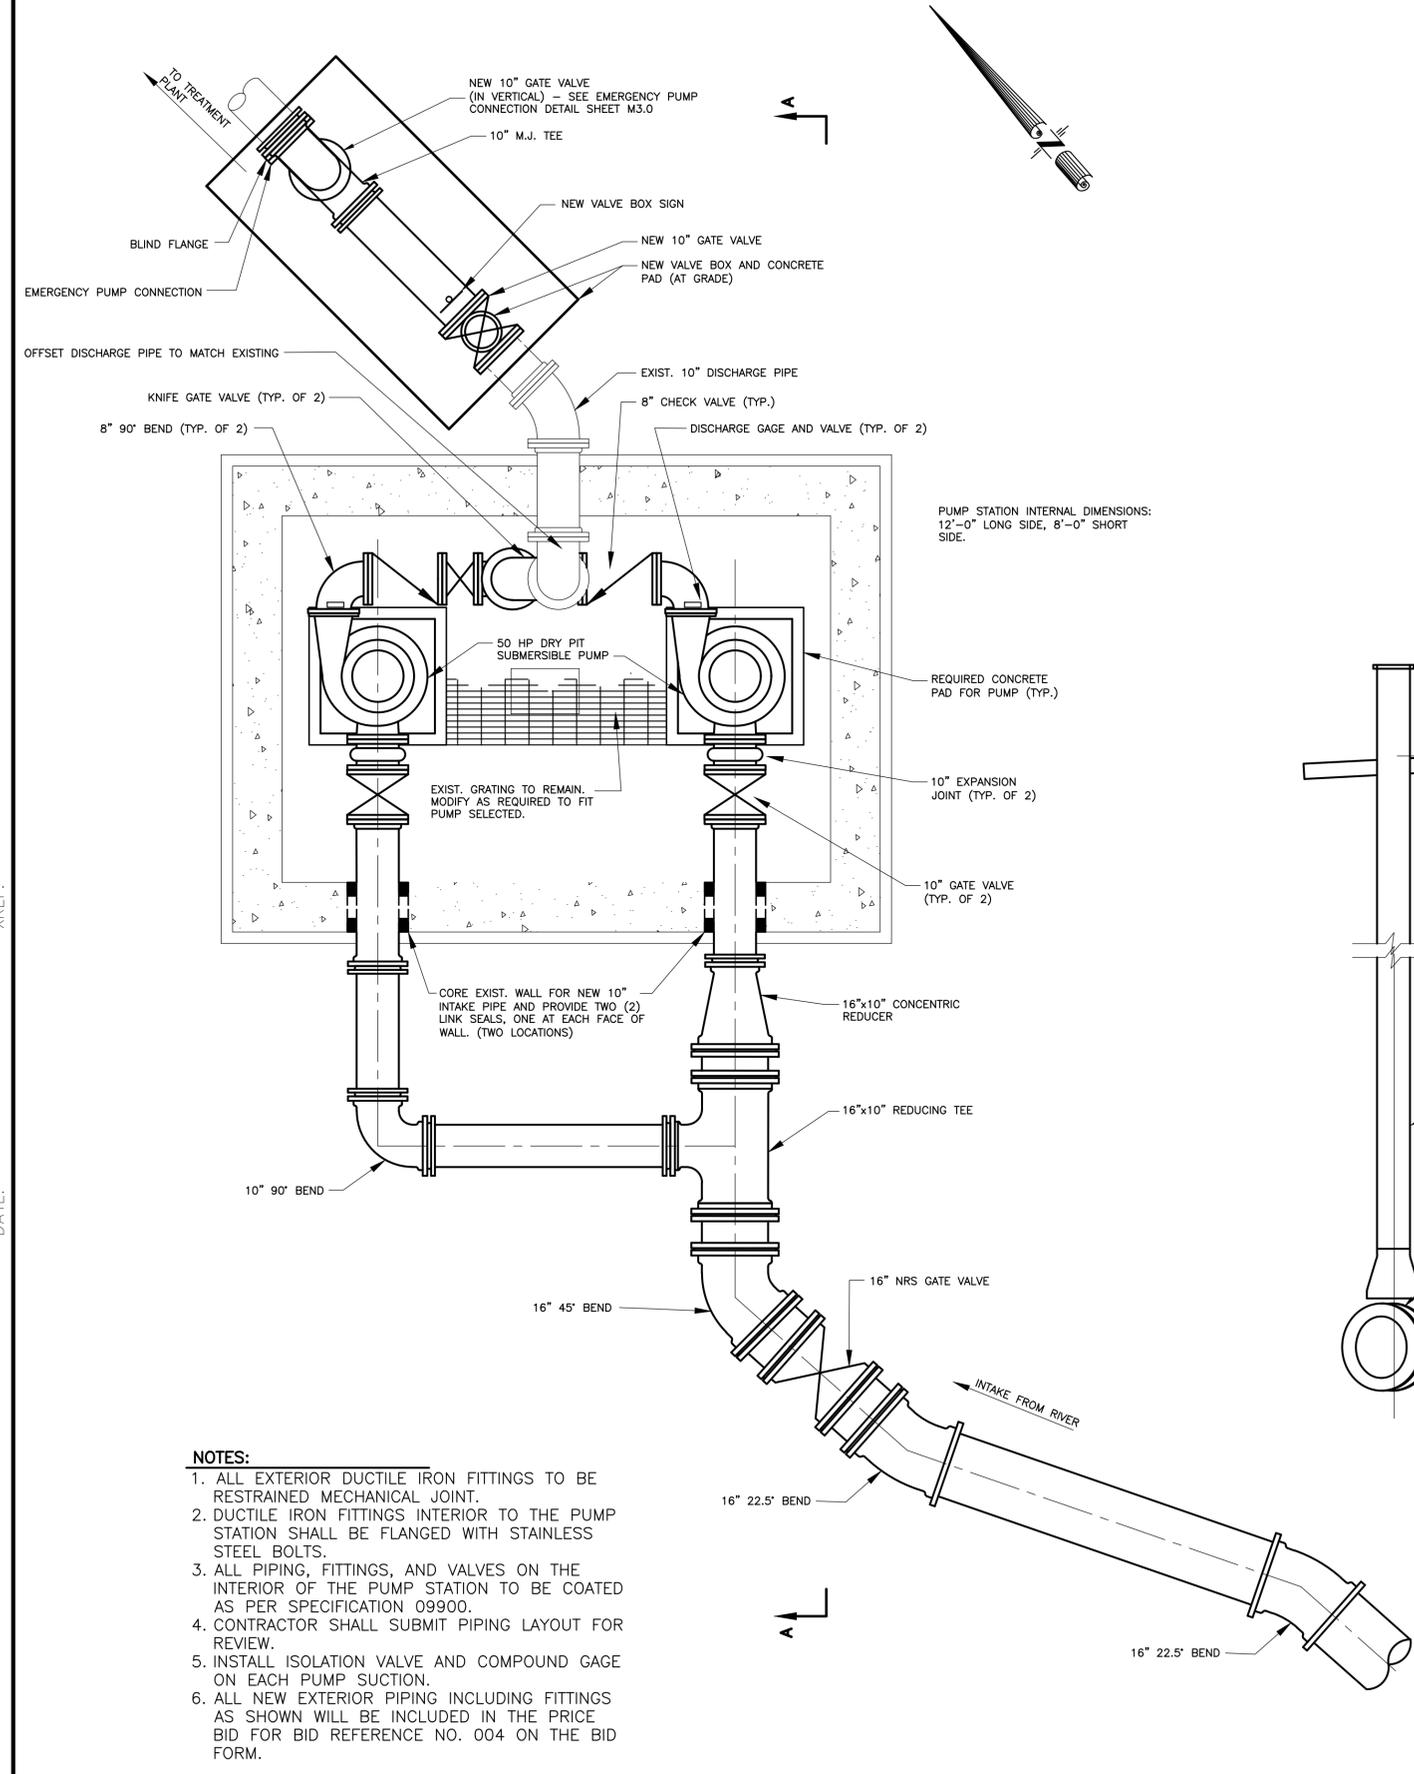

SECTION A-A
 SCALE : 1/2"=1'-0"

- NOTES:**
1. ALL EXTERIOR DUCTILE IRON FITTINGS TO BE RESTRAINED MECHANICAL JOINT.
 2. DUCTILE IRON FITTINGS INTERIOR TO THE PUMP STATION SHALL BE FLANGED WITH STAINLESS STEEL BOLTS.
 3. ALL PIPING, FITTINGS, AND VALVES ON THE INTERIOR OF THE PUMP STATION TO BE COATED AS PER SPECIFICATION 09900.
 4. CONTRACTOR SHALL SUBMIT PIPING LAYOUT FOR REVIEW.
 5. INSTALL ISOLATION VALVE AND COMPOUND GAGE ON EACH PUMP SUCTION.
 6. ALL NEW EXTERIOR PIPING INCLUDING FITTINGS AS SHOWN WILL BE INCLUDED IN THE PRICE BID FOR BID REFERENCE NO. 004 ON THE BID FORM.

PLAN OF PROPOSED STATION IMPROVEMENTS
 SCALE : 1/2"=1'-0"

STATE OF LOUISIANA
 ROBERT D. BREDBERG
 License No. 30639
 PROFESSIONAL ENGINEER
 IN
 MECHANICAL ENGINEERING
 11-28-18

DATE: XREF: FILE NAME: